

Assembling Instruction Split-core type CT GSKF 1

Disassembling of the CT:

To split the CT into two halves, remove the four hex socket-head screws (2) and the spring (3). Be sure to lift the upper part of the ct horizontally when disassembling, otherwise plug or socket can be damaged. Place the upper part of the split core CT at the side.

Attention: Prevent split core surfaces from any damage when mounting!


Assembling:

Place the lower part of the split core CT at its mounting position and fix the base plate with screws. Clean the surfaces of the split core with a duster and apply vaseline on the surfaces. Keep the primary conductor in the window and replace the upper part of the split core CT to enclose the conductor completely. The position „face to face“ of the two rating plates and of the indications „P1“ gives the correct mounting of the two parts of the split core CT. When mounting several split core CTs the serial number indicates the assembling of the two matching parts of each split core CT. Replace springs (3) and hex socket-head screws and tighten the screws crosswise only by hex socket-head screw driver under manual force (8-10 Nm). During assembly of the CT it is critical that all gaskets close in alignment to each other. It has to be guaranteed that no humidity is able to enter neither the terminal box nor the split surfaces. In case of horizontal mounting of the split core CT an additional support shall be installed to prevent the split core from air gaps.



Check measurement:

To check the perfect fitting of both CT halves the measuring of the magnetization curve has to be realized. One relevant magnetization value is indicated on the rating plate (exp. $U_0 = 50V / I_0 = 12 mA$).

Dimensions

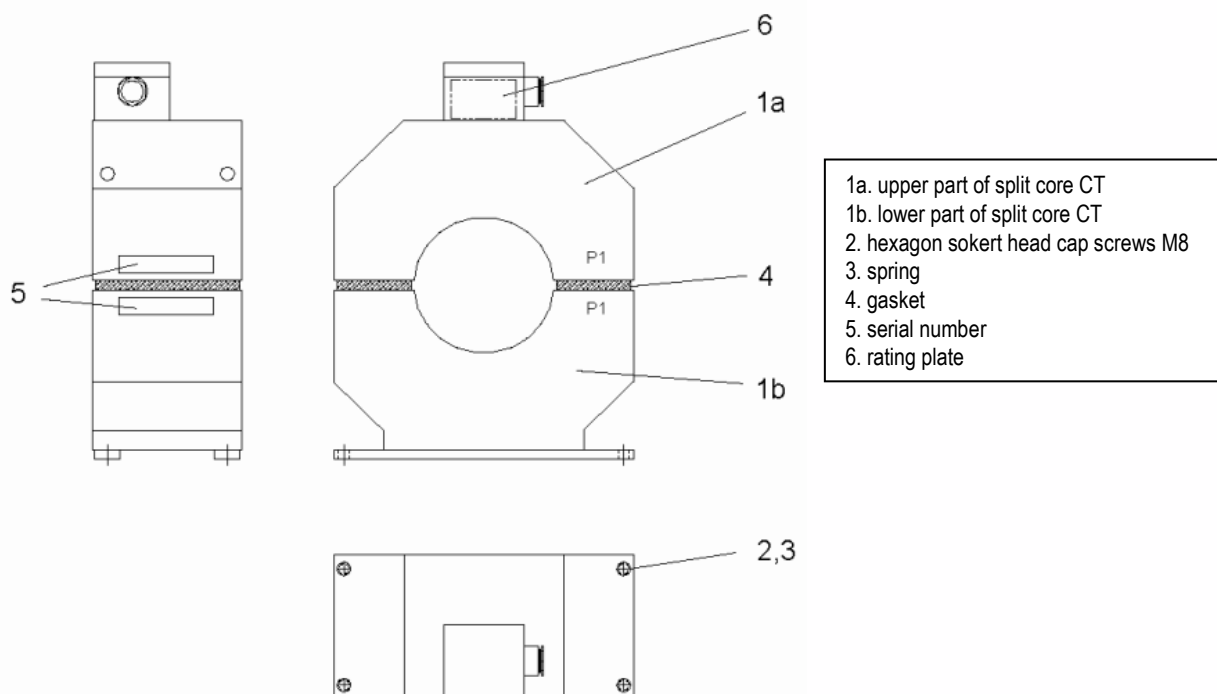

Assembling Instruction Split-core type CT GSKF 2

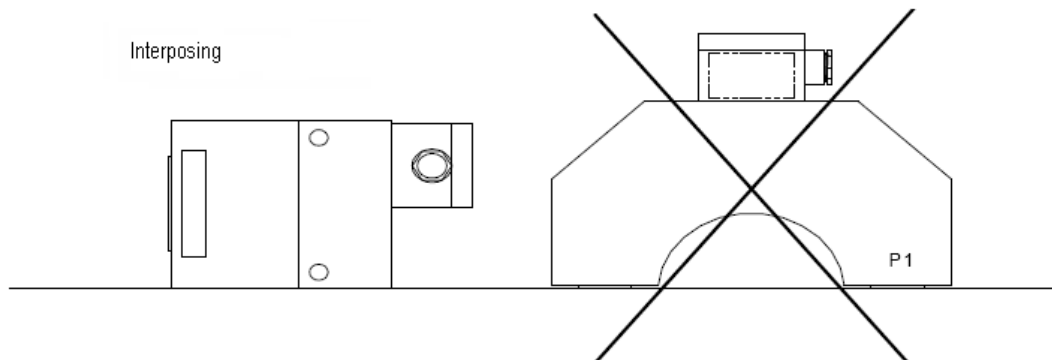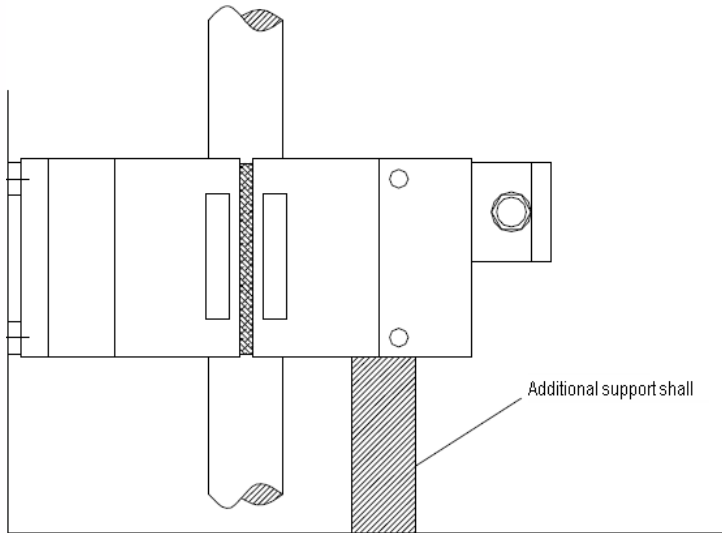

Wiring Diagram

